

# CodeNotes<sup>™</sup>



2015 ISPSC® Permanent Inground Residential Swimming Pool Entry/Exit Requirements

## Introduction

This CodeNotes<sup>™</sup> provides an overview of entry/exit requirements of the 2015 International Swimming Pool and Spa Code<sup>®</sup> (ISPSC<sup>®</sup>) as they pertain to permanent inground residential swimming pools.


All pools shall have a means of entry and exit in the shallow areas if water depth exceeds 24 inches (610 mm) at the shallowest point. The means of entry and exit shall be located on the shallow side of any first slope change (Ref. Section 809.2 of the 2015 ISPSC).

Entries and exits shall consist of one, or a combination of, the following: steps, stairs, ladders, treads, ramps, beach entries, underwater seats, benches, swimouts, and other approved designs (Ref. Section 809.2 of the 2015 ISPSC. All treads shall have slip resisting surfaces. (Ref. Section 322.3 and 322.4 of the 2015 ISPSC).

A secondary means of entry and exit shall be provided in the deep area of the pool if the water depth exceeds 5 feet (1.52 m) (Ref. Section 809.3 of the 2015 ISPSC). Pools over 30 feet (914cm) in width at the deep area shall have an entry and exits on both sides of the deep area of the pool (Ref. Section 809.4 of the 2015 ISPSC).

#### **Recessed Treads**

Recessed treads shall have a minimum depth of not less than 5 inches (127 mm) and a width of not less than 12 inches (305 mm). The vertical distance between the pool coping edge, deck, or step surface and the uppermost recessed tread shall not be greater than 12 inches (305 mm). A recessed tread is a pocket built into the wall of a pool that is large enough for a foothold. A vertical series of recessed tread provides the user with a ladder effect to climb out of the pool. Slip resistant surfaces on recessed treads are required and especially necessary in a wet environment.

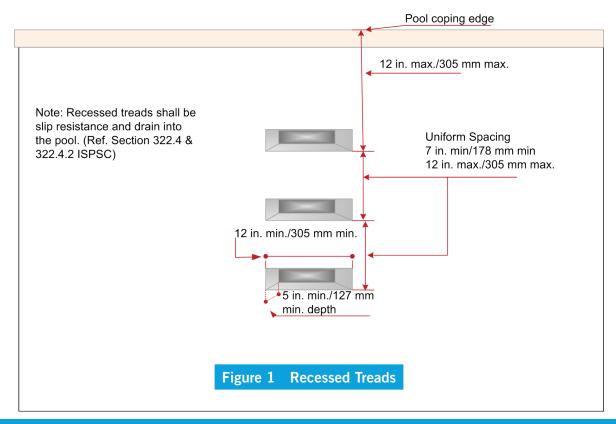

## **Pool Stairs**

Section 809.5.1 requires that treads dimension have a minimum unobstructed horizontal depth of 10 inches (254 mm) and a minimum unobstructed surface area of 240 square inches (0.15 m²). The thinking is that a minimum tread depth provides for the entire placement of an adult foot. The minimum area of the step provides for an adult to stand comfortably with both feet on the step.

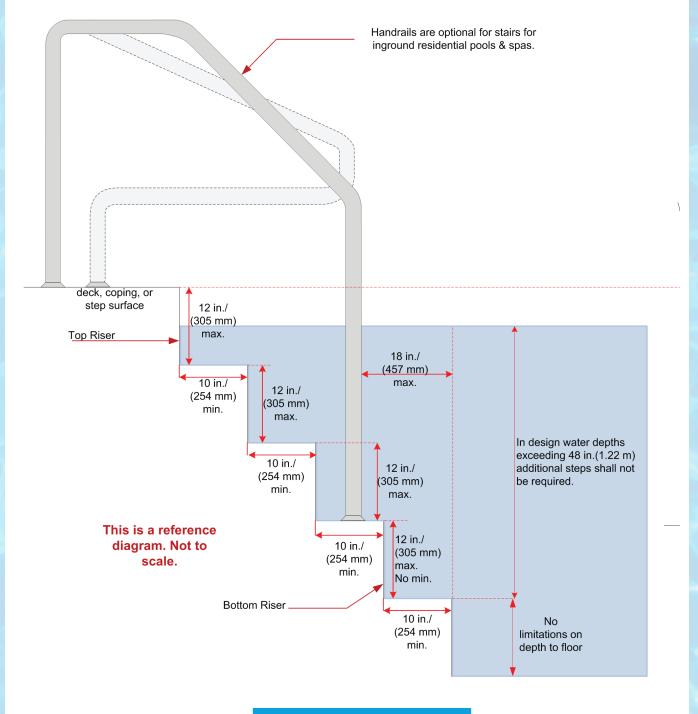


Figure 2 Pool Stairs Side View

# **Pool Ladder & Handrail Requirements**

Climbing a ladder is nearly impossible without using two hands on separate handhold or handrails. The clear distance between ladder handrails shall be not less than 17 inches (432 mm) and not greater than 24 inches (610 mm). The separation between the handrails is necessary to provide stability for the ladder user. See next page for a side view.

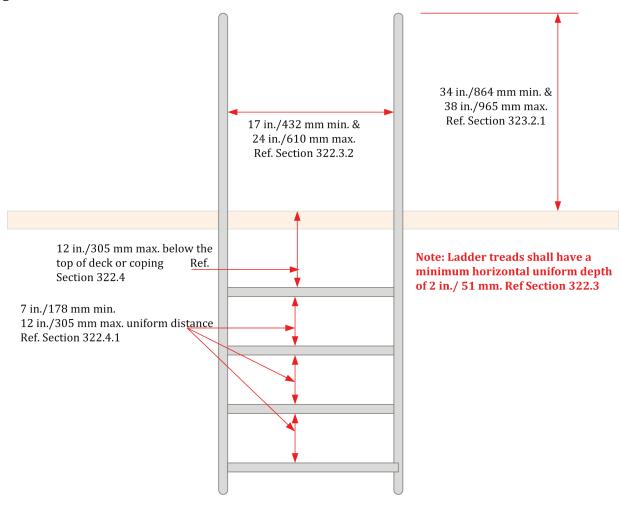


Figure 3 Pool Ladder

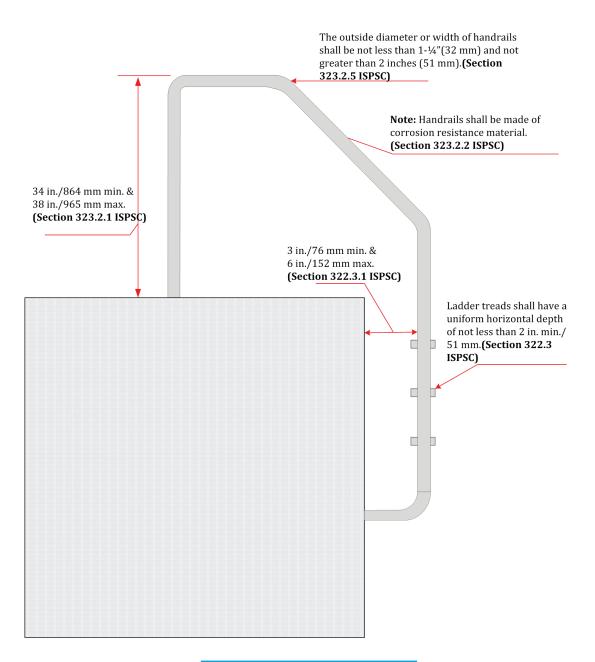


Figure 4 Handrails (side view)



Please contact the International Code Council to order the *International Swimming Pool and Spa Code, ISPSC Commentary* or other code support publications.

www.iccsafe.org/store | 1-800-786-4452

Copyright © 2016
International Code Council
www.iccsafe.org
1-888-422-ICC-SAFE
(422-7233)



